

LABORATORY MEASUREMENT OF THE REDUCTION OF TRANSMITTED IMPACT SOUND PRESSURE LEVELS BY A FLOOR COVERING ON A HEAVYWEIGHT STANDARD FLOOR.

Measurement No: INR157
Date of Measurement: 16 – 23 June, 2008
Commissioned by: A1 Rubber Pty Ltd,
34 Binary St,
(Box 6278),
Yatala,
QLD, 4207.

Summary

The reduction of impact sound pressure level (ΔL), the impact isolation class (IIC), $L_{n,w}$ and C_i , the weighted reduction in impact sound pressure level (ΔL_w) and the ΔL_{lin} value for fourteen (14) different tile/timber/vinyl floor covering systems have been measured.

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

The ΔL values reported are the decibel reductions in normalized impact sound pressure level (L_n) measured in a reverberant room beneath the test floor, achieved by the floor covering material compared to the bare test floor. The ΔL_w and ΔL_{lin} are single number ratings for the improvement in impact sound levels between the bare reference floor and the same floor with the floor covering material. ΔL_w is the difference between $L_{n,w}$ for the bare reference floor and $L_{n,w}$ for the reference floor plus the floor covering, as defined in AS ISO 717.2-2004. ΔL_{lin} is the difference between $L_{n,sum}$ for the bare reference floor and $L_{n,sum}$ for the reference floor plus the floor covering combination, as defined in AS ISO 717.2-2004. IIC (ASTM E989-89), $L_{n,w}$ and C_i AS ISO 717.2-2004 apply to the combination of the floor covering and the 150mm thick concrete test slab.

© 2008 CSIRO

To the extent permitted by law, all rights are reserved and no part of this publication covered by copyright may be reproduced or copied in any form or by any means except with the written permission of CSIRO.

While CSIRO takes care in preparing the reports it provides to clients, it does not warrant that the information in this particular report will be free of errors or omissions or that it will be suitable for the client's purposes. CSIRO will not be responsible for the results of any actions taken by the client or any other person on the basis of the information contained in the report or any opinions expressed in it.

Method of Testing

(a) Specific

The measurement complies with the requirements of ISO 140-8:1997(E) "Measurement of sound insulation in buildings and building elements – Part 8: Laboratory measurement of the reduction in transmitted impact noise by floor coverings on a standard floor". It also complies with ISO 140-6 "Measurement of sound insulation in buildings and building elements – Part 6: Laboratory measurement of sound insulation of floors".

(b) General

The test-material is installed onto a standard test-floor, this being a 150mm reinforced concrete slab satisfying the requirements of ISO 140-8. A standard tapping-machine is operated on the test-material, and again on the bare-floor. The reduction in the sound pressure levels produced in a chamber beneath the floor is reported. Measurements for the floor covering are made at four different tapping machine positions on the standard test-floor and the average results reported.

Description of Materials Tested, and Mounting

The floor-covering systems, each with the dimensions of 3.6m x 3.2m, were tested on a 150mm thick concrete slab. The systems comprised, from the top down:

(a) Test "a".

- MJS 14mm thickness Tru Timber Flooring
- Loose laid over:
- A1 Rubber "AcoustaMat" 3mm thickness 850 kg/m³ density
- Loose laid over:
- 150mm thickness concrete slab

(b) Test "b".

- MJS 14mm thickness Tru Timber Flooring
- Loose Laid over:
- A1 Rubber "AcoustaMat" 3mm thickness 850 kg/m³ density
- Loose laid over:
- 150mm thickness concrete slab

(c) Test "c".

- Armstrong 2mm thickness Vinyl plank
- Glued using HB Fullers Floorbond XMS Adhesive to:
- A1 Rubber "AcoustaCork" 3mm thickness 720 kg/m³ density
- Glued using HB Fullers Floorbond XMS Adhesive to:
- 150mm thickness concrete slab

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

(d) Test “d”.

- Gunns 19mm thick Solid Timber Flooring
- Glued using Selleys Liquid Nails “Direct Stick” to:
- 15mm thick plywood
- Glued using Selleys Liquid Nails “Direct Stick” to:
- A1 Rubber “AcoustaMat” 5mm thickness 700 kg/m³ density
- Glued using Selleys Liquid Nails “Direct Stick” to:
- 150mm thickness concrete slab

(e) Test “e”.

- Gunns 19mm thick Solid Timber Flooring
- Glued using Selleys Liquid Nails “Direct Stick” to:
- 15mm thick plywood
- Glued using Selleys Liquid Nails “Direct Stick” to:
- A1 Rubber “AcoustaMat Tiles” 1m² 15mm thickness 600 kg/m³ density
- Glued using Selleys Liquid Nails “Direct Stick” to:
- 150mm thickness concrete slab

(f) Test “f”.

- Big River 14mm Engineered Timber Flooring
- Glued using Sika-Bond T55-J Adhesive to:
- A1 Rubber “AcoustaMat” 5mm thickness 700 kg/m³ density
- Glued using Sika-Bond T55-J Adhesive to:
- 150mm thickness concrete slab

(g) Test “g”.

- MJS 14mm thickness Tru Timber Flooring
- Glued using MJS LVP Adhesive to:
- A1 Rubber “AcoustaCork” 3mm thickness 720 kg/m³ density
- Glued using MJS LVP Adhesive to:
- 150mm thickness concrete slab

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

(h) Test “h”.

- MJS 14mm thickness Tru Timber Flooring
- Glued using Sika-Bond T55-J Adhesive to:
- A1 Rubber “AcoustaMat” 3mm thickness 850 kg/m³ density
- Glued using Sika-Bond T55-J Adhesive to:
- 150mm thickness concrete slab

(i) Test “i”.

- Big River 14mm Engineered Timber Flooring
- Glued using HB Fullers Floorbond XMS Adhesive to:
- A1 Rubber “AcoustaMat” 3mm thickness 850 kg/m³ density
- Glued using HB Fullers Floorbond XMS Adhesive to:
- 150mm thickness concrete slab

(j) Test “j”.

- Armstrong 2mm Armalon NG Sheet Vinyl
- Glued using Maxbond 107 High Grab Vinyl and Sheet Vinyl Adhesive to:
- Hardboards Australia 5.1mm thickness Dual Bond Masonite
- Loose laid over:
- A1 Rubber “AcoustaMat” 3mm thickness 850 kg/m³ density
- Loose laid over:
- 150mm thickness concrete slab

(k) Test “k”.

- Granito 400mm x 400mm x 10mm thickness Porcelain Ceramic Tile
- Grouted with Laticrete # 1524
- Glued using Laticrete Tile Adhesive # 335 to:
- A1 Rubber “AcoustaCork” 5mm thickness 720 kg/m³ density
- Glued using Laticrete Tile Adhesive # 335 to:
- 150mm thickness concrete slab

(l) Test “l”.

- Granito 400mm x 400mm x 10mm thickness Porcelain Ceramic Tile
- Grouted with Laticrete # 1524
- Glued using Laticrete Tile Adhesive # 335 to:
- A1 Rubber “AcoustaMat” 6mm thickness 700kg/m³ density
- Glued using Laticrete Tile Adhesive # 335 to:
- 150mm thickness concrete slab

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

(m) Test “m”.

- Granito 400mm x 400mm x 10mm thickness Porcelain Ceramic Tile
- Grouted with Laticrete # 1524
- Laid over:
- 20mm thickness Laticreed bed over:
- A1 Rubber “AcoustaMat” 5mm thickness 700 kg/m³ density
- Loose laid over:
- 150mm thickness concrete slab

(n) Test "n".

- Granito 400mm x 400mm x 10mm thickness Porcelain Ceramic Tile
- Grouted with Laticrete # 1524
- Laid over:
- 20mm thickness Latiscreed bed over:
- A1 Rubber "AcoustaCork" 5mm thickness 720 kg/m³ density
- Loose laid over:
- 150mm thickness concrete slab

Description of Test Floor and Test Facility

The standard floor used was a reinforced concrete floor with dimensions 3.66 m x 3.20 m x 0.150 m - this is in accordance with the requirements of ISO 140-8.

The tests were conducted with the standard floor-slab placed in an aperture between two purpose-built concrete rooms, all the bounding surfaces of which are 305 mm in thickness. The rooms were designed and built to minimise any structure-borne noise (induced by test signals) from outflanking sound passing through the test specimen.

The "sending" and the "receiving" rooms are both pentagonal in shape; the receiving room has a volume of 105 m³ and a floor area of 32 m².

Environmental Conditions

The environmental conditions existing in the chambers during the testing were:

Temperature	14.4 – 14.8 deg C,
Relative Humidity	70 – 76 %
Atmospheric pressure	1020 - 1025 hPa

Measuring Equipment

(a) Tapping Machine

The tapping machine employed was a Brüel & Kjær type 3204 (a rotating cam allows five, 500 gm, steel hammer-heads to be raised, then dropped under gravity through 40 mm, at a rate of 10 impacts/s). The tapping machine fulfils the requirements of ISO 140.

(b) Microphone

The microphone used was a Brüel & Kjær type 4166 mounted on a Brüel & Kjær type 2619 preamplifier and was mounted at end of a rotating boom of radius 1.73 m which had a rotation period of 32 s.

(c) Calibration of Microphone Sensitivity

The gain of the microphone was adjusted to read absolute dB re 20 µPa prior to measurement by using a Brüel & Kjær type 4220 pistonphone. The pistonphone was calibrated by a NATA registered laboratory on 20 April 2007.

(d) Analysis Equipment

Microphone signals were analysed using a Norwegian Electronics type 830 Real-Time-Analyser (RTA). This enables measurements in each of the standard 1/3-octave bands simultaneously, and also can perform internal averaging of repeated measurements. The measured levels reported below are each the result of internally averaging 4 x 32 s integrals in the 100 Hz to 5000 Hz bands.

The reverberation times in the receiving room were measured by overlaying 60 decays using the internal program of the RTA.

Measured Impact Sound Pressure Levels

Table 1 presents the impact sound pressure level (L_i), corrected for background levels, for the Bare Floor (L_{i0}) and each specimen averaged over four different tapping machine positions as measured in the receiving room.

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

Table 1.

Measured impact sound pressure level (L_i), corrected for background levels, averaged over four different tapping machine positions for the reference-floor and the floor-coverings laid over the reference-floor.

Freq (Hz)	L _{io} (dB)	L _i (dB)													
		(a) Test "a"	(b) Test "b"	(c) Test "c"	(d) Test "d"	(e) Test "e"	(f) Test "f"	(g) Test "g"	(h) Test "h"	(i) Test "i"	(j) Test "j"	(k) Test "k"	(l) Test "l"	(m) Test "m"	(n) Test "n"
100	65.3	64.2	64.4	63.7	63.3	68.2	63.9	65.6	66.2	63.9	64.2	63.8	63.3	65.3	64.9
125	69.6	66.8	67.1	66.3	66.5	70.9	65.1	66.9	67.4	65.5	64.8	66.8	66.9	68.2	66.4
160	72.0	69.4	68.5	66.6	67.5	72.6	68.8	70.1	70.5	66.9	68.1	68.0	68.3	71.6	69.3
200	75.4	74.2	73.6	72.0	73.3	74.8	74.2	75.8	76.5	72.4	72.4	74.2	74.3	76.6	73.3
250	77.9	74.9	74.1	72.0	75.1	73.6	75.1	75.7	76.5	74.7	71.5	75.5	75.4	75.0	74.5
315	80.1	75.8	75.5	73.4	77.7	72.2	73.9	75.7	76.1	77.1	67.6	76.7	76.3	71.6	75.7
400	77.3	71.9	72.0	69.5	74.4	67.8	73.0	76.0	75.7	75.5	65.4	74.5	74.5	70.5	74.3
500	77.3	69.2	69.1	67.1	71.1	65.8	70.9	71.9	72.0	73.7	62.0	74.7	74.3	67.0	69.7
630	78.4	68.2	65.7	63.3	69.6	63.6	69.1	69.3	65.8	71.0	57.0	73.2	73.1	66.1	69.0
800	78.4	62.4	60.8	58.0	67.3	58.6	65.4	66.1	61.4	67.1	46.9	71.0	72.3	61.8	63.8
1000	79.3	60.5	58.1	52.9	66.3	54.1	62.9	64.6	58.4	63.5	38.1	69.1	69.5	58.7	60.9
1250	79.6	56.6	53.4	44.5	64.5	50.2	59.1	61.5	56.3	60.0	33.9	69.5	67.1	55.7	58.5
1600	79.3	51.8	48.3	35.3	61.1	44.9	52.2	55.2	51.6	55.7	28.3	68.3	66.7	52.0	54.9
2000	78.5	45.5	41.3	29.0	54.7	38.9	45.7	47.4	46.7	48.7	24.4	64.6	62.5	46.7	49.6
2500	76.9	42.0	35.7	22.1	49.3	32.4	39.8	39.8	41.1	43.0	21.1	59.5	56.7	42.6	45.1
3150	75.5	35.2	31.3	17.8	44.4	24.9	32.9	29.2	34.3	37.3	19.2	53.3	50.1	37.4	39.5
4000	72.9	29.0	26.0	13.2	35.6	17.5	25.2	19.0	26.3	30.6	16.8	46.6	43.6	30.2	33.0
5000	70.0	22.2	20.2	11.4	27.4	12.2	18.1	13.8	17.5	24.5	14.3	40.0	38.6	21.6	25.5

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

Correction for Background Sound Pressure Level

ISO 140-6 & 8 both require the measured impact sound pressure level to be corrected if it is close to the background sound pressure level. The symbol \geq indicates that the measured Sound Pressure Level was less than the required 6 dB above background. In this case 1.3 dB was subtracted from the measured Sound Pressure Level, this being the correction required for a measured Sound Pressure Level of 6 dB above background. All corrections are presented in Table 2.

Table 2. Background Corrections

Freq (Hz)	Size of correction, dB			
	(c) Test "c"	(e) Test "e"	(g) Test "g"	(j) Test "j"
4000	0.8			
5000	≥ 1.3	≥ 1.3	1.0	0.9

Normalised Impact Sound Pressure Level of Bare Floor

ISO 140-6 & 8 both require the reporting of the normalised impact sound pressure level for the bare floor, L_{no} . The normalised impact sound pressure levels are the levels that would be measured if exactly 10 m² of sound absorption was present in the receiving room at each frequency. Accordingly, this information is presented in Table 3, together with the normalised impact sound pressure level for the test floors.

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

Table 3. Normalised impact sound pressure levels (dB) for the test floors.

Freq (Hz)	Bare Floor	Normalised Impact Sound Pressure Level (L_{in})													
		(a) Test "a"	(b) Test "b"	(c) Test "c"	(d) Test "d"	(e) Test "e"	(f) Test "f"	(g) Test "g"	(h) Test "h"	(i) Test "i"	(j) Test "j"	(k) Test "k"	(l) Test "l"	(m) Test "m"	(n) Test "n"
100	56.7	55.6	55.8	55.1	55.0	59.6	55.3	57.0	57.6	55.8	56.1	55.4	54.9	57.0	56.6
125	60.7	57.9	58.2	57.4	57.6	62.0	56.2	58.0	58.5	57.6	56.9	58.7	58.5	60.1	58.3
160	63.1	60.5	59.6	57.7	59.0	63.7	59.9	61.2	61.6	58.6	59.8	59.6	59.5	63.2	60.9
200	67.3	66.1	65.5	63.9	65.2	66.7	66.1	67.7	68.4	64.4	64.4	66.2	66.3	68.5	65.2
250	70.1	67.1	66.3	64.2	67.0	65.8	67.3	67.9	68.7	67.0	63.8	67.8	67.7	67.1	66.6
315	72.9	68.6	68.3	66.2	70.4	65.0	66.7	68.5	68.9	70.0	60.5	69.6	69.1	64.5	68.6
400	70.4	65.0	65.1	62.6	67.9	60.9	66.1	69.1	68.8	68.7	58.6	67.6	67.6	63.6	67.4
500	70.8	62.7	62.6	60.6	64.4	59.3	64.4	65.4	65.5	67.3	55.6	68.3	67.8	60.6	63.3
630	72.2	62.0	59.5	57.1	63.4	57.4	62.9	63.1	59.6	64.8	50.8	67.0	66.9	59.9	62.8
800	72.5	56.5	54.9	52.1	62.6	52.7	59.5	60.2	55.5	61.2	41.0	65.1	66.4	55.9	57.9
1000	73.9	55.1	52.7	47.5	60.9	48.7	57.5	59.2	53.0	58.1	32.7	63.7	64.0	53.2	55.4
1250	74.6	51.6	48.4	39.5	59.4	45.2	54.1	56.5	51.3	55.0	28.9	64.5	62.0	50.6	53.4
1600	74.9	47.4	43.9	30.9	56.7	40.5	47.8	50.8	47.2	51.3	23.8	63.9	62.3	47.6	50.5
2000	74.9	41.9	37.7	25.4	51.1	35.3	42.1	43.8	43.1	45.1	20.8	60.9	58.8	43.0	45.9
2500	74.1	39.2	32.9	19.2	46.9	29.5	37.0	37.0	38.3	40.1	18.3	56.6	53.8	39.7	42.2
3150	73.4	33.1	29.2	15.7	42.0	22.8	30.8	27.1	32.2	35.1	17.0	51.1	47.9	35.3	37.4
4000	71.5	27.6	24.6	11.8	34.2	16.1	23.9	17.6	24.9	29.1	15.3	45.1	42.1	28.7	31.5
5000	69.5	21.7	19.6	10.9	26.8	11.7	17.6	13.3	16.9	23.9	13.7	39.3	37.9	21.0	24.9

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

Results


The reduction of impact sound pressure level (ΔL), (i.e. the improvement in impact sound insulation) is given by the simple difference between the sound pressure level (L_{id}) measured for the bare floor, and the (L_i) measured for the test floors, corrected where appropriate for background levels. The impact isolation class (IIC) on the 150mm thick test slab, as defined in ASTM E989-89, the weighted reduction in impact sound pressure level ΔL_w , and ΔL_{lin} , as defined in AS ISO 717.2-2004, have also been determined for the test floors.

Table 4 presents the reduction of impact sound pressure level (ΔL) calculated for each measured third octave frequency band. The last five rows of the tables give ΔL_w , ΔL_{lin} , IIC, $L_{n,w}$ and C_I respectively for the test floors.

The bare floor yielded IIC 27, $L_{n,w}$ 80 and C_I -11

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

測試報告所有權為台亨貿易所有，未經授權請勿轉載應用

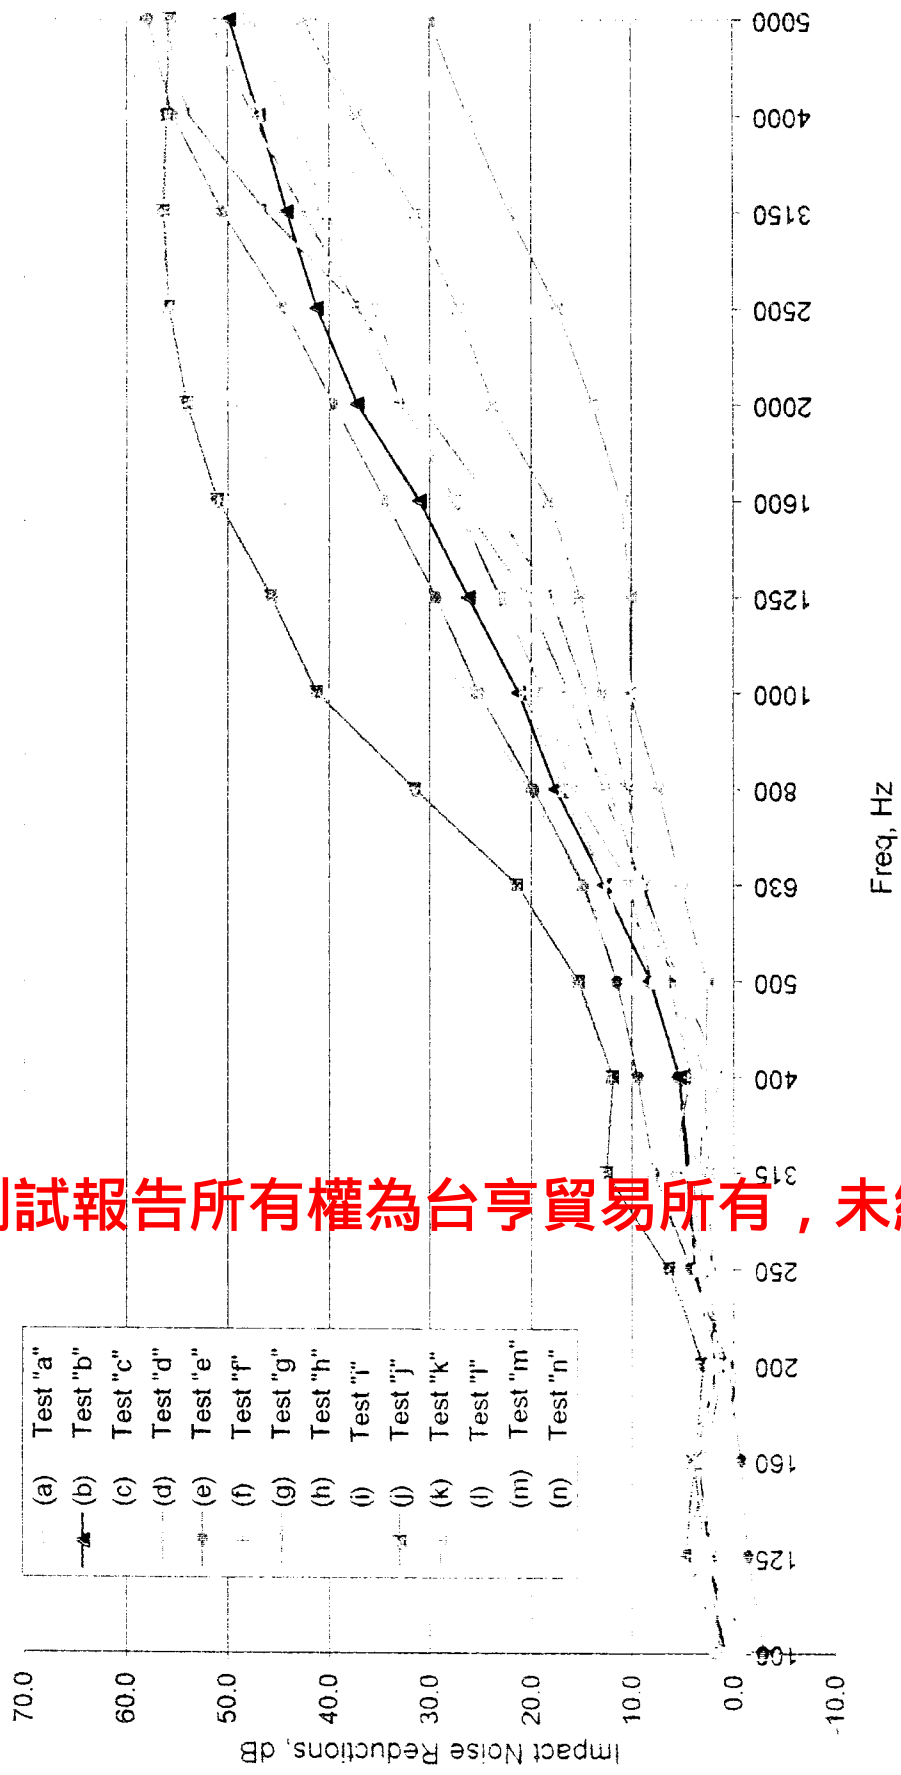

INR157